




*Meeting Your Waste Material
 & Septic System Needs*

NOTES:

1. Bottom of trench must be level. Top of trench rock must be level.
2. Distribution pipe shall be installed level and covered with 2 inches of trench rock.
3. Distribution pipe shall be perforated plastic with 1/2 inch or larger holes. One of the rows of holes must be located along the bottom of the pipe. Pipe must have a bearing strength of at least 1000lb/ft.
4. Scarify trench bottom and sidewalls as high as rock will be placed in the trench in order to expose natural soil. Remove loose soil before placing rock.

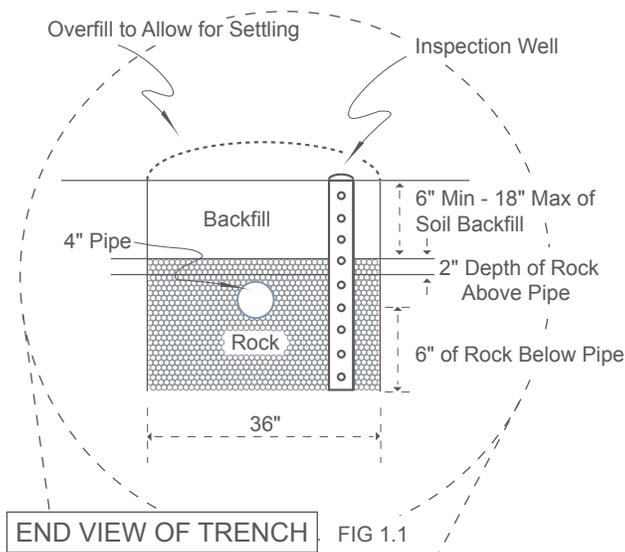

END VIEW OF TRENCH FIG 1.1

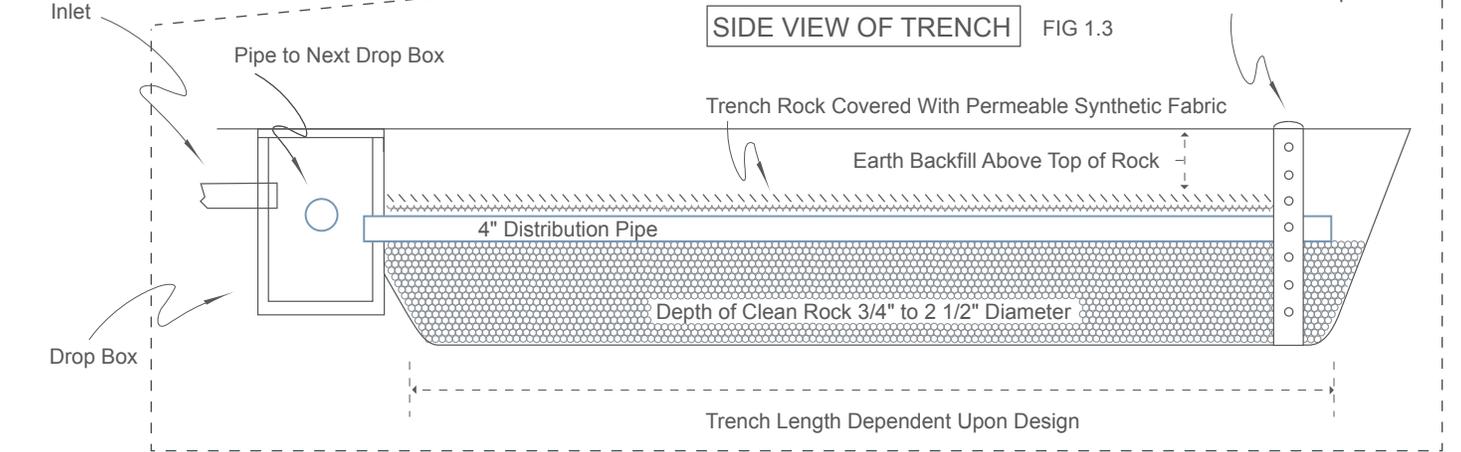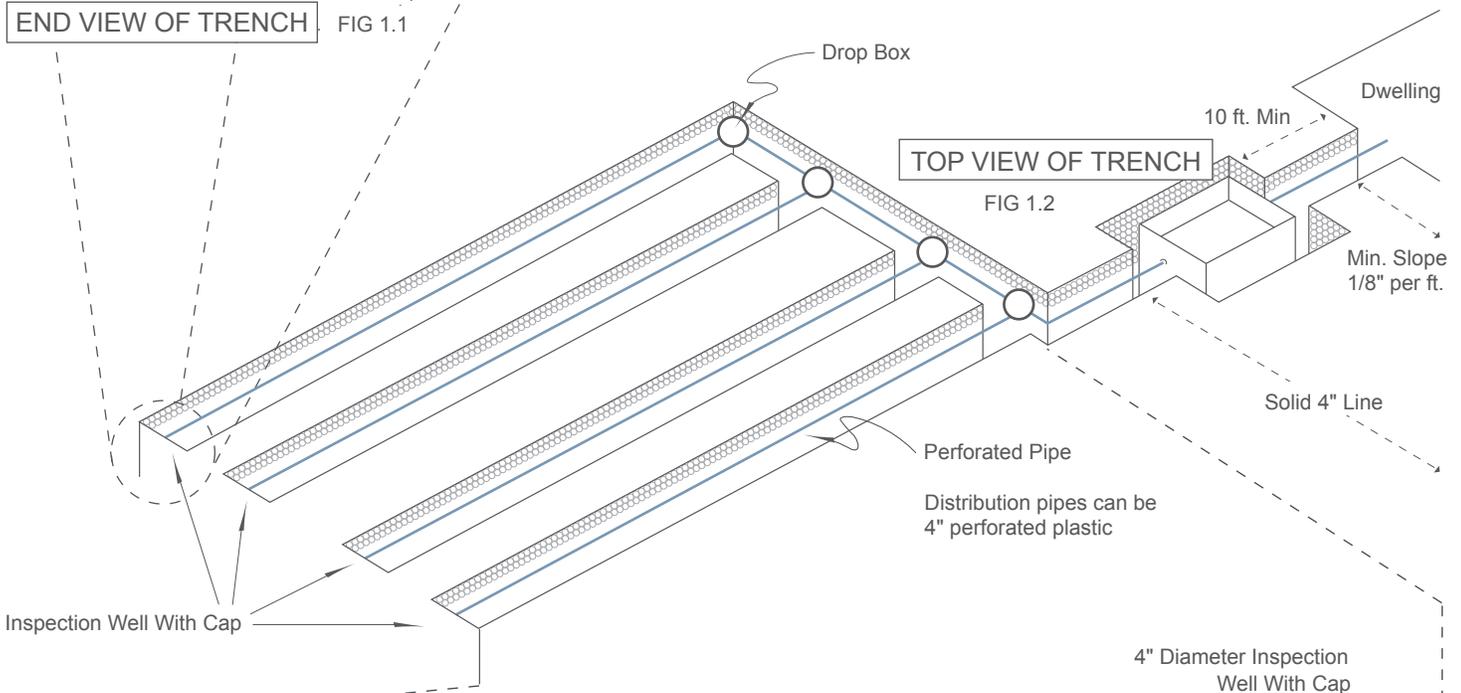

SIDE VIEW OF TRENCH FIG 1.3